

Design of a Virtual Lab to Evaluate and Mitigate Power Quality Problems Introduced by Microgeneration

Sonia Pinto, J. Fernando Silva, Filipe Silva and Pedro Frade
*DEEC; Instituto Superior Técnico, TULisbon,
Cie3 – Centre for Innovation in Electrical and Energy Engineering
Portugal*

1. Introduction

The technological advances of the last decades favored a widespread of power electronics converters in the majority of household appliances, industrial equipment connected to the Low Voltage (LV) grid and, more recently, in distributed power generation, near the consumer – microgeneration (μ G).

Most of this electronic equipment is a strong producer of current harmonics, polluting the LV network and generating sensitivity to dips, unbalances and harmonics, being also more sensitive to Power Quality issues. In the future, the massive use of renewable and decentralized sources of energy will probably worsen the problem, increasing Total Harmonic Distortion (THD), RMS voltage values, increasing unbalances and decreasing Power Factor in Low Voltage Networks.

In these and in other Power Quality related issues, power electronics became, to a certain extent, the cause of the problem. However, due to the continuous development of power semiconductors characteristics, less demanding drive circuits, integration in dedicated modules, microelectronic control circuits improvement, allowing their operation at higher frequencies and with higher performance modulation and control methods, power electronics converters also have the potential to become the solution for the problem. Still, even the non polluting grid connected converters are not usually exploited to their full capability as, in general, they are not used to mitigate Power Quality problems.

The smart exploitation of μ G systems may become very attractive, using power electronics converters and adequate control strategies to allow the local mitigation of some power quality problems, minimizing the LV grid harmonics pollution (near unitary power factor) and guaranteeing their operation as active power filters (APF).

Based on these new challenges, the main aim of this work is to create a virtual LV grid laboratory to evaluate some power quality indicators, including power electronics based models to guarantee a more realistic representation of the most significant loads connected to the LV grid. The simulated microgenerators are represented as Voltage Source Inverters (VSI) and may be controlled to guarantee: a) near unity power factor (conventional μ G); b) local compensation of reactive power and harmonics (active μ G).

From the obtained results, active μ G have the capability to guarantee an overall Power Quality improvement (voltage THD decrease and Power Factor increase) allowing a voltage THD decrease when compared to voltage THD values obtained with conventional μ G.

2. Model of Low Voltage grid

The power electronics based low voltage network model is obtained using the SimPowerSystems Toolbox of Matlab/ Simulink. The models include the Medium/ Low voltage (MV/ LV) transformer, the distribution lines, the most significant electrical loads and the microgenerators connected to the grid.

2.1 Distribution transformer

It is assumed that the distribution MV/ LV transformer is Δ YN, with the secondary neutral directly connected to ground. The transformer used in the simulations is fed by a 30kV voltage on MV (medium voltage) and, in LV (Low Voltage) the line/ phase voltage is 400V / 230V. The magnetization and the primary and secondary windings reactance and resistance are calculated from the transformer manufacturer no-load, short-circuit and nominal load tests [Elgerd, 1985].

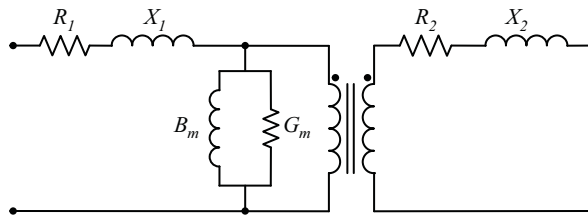


Fig. 1. Equivalent single phase model of a distribution transformer

From the no-load test, applying the nominal voltage U_n to the secondary side of the transformer, and leaving the primary side open, it is possible to obtain the transformer magnetizing current I_m . As the series impedance is much lower than the magnetizing impedance, it is assumed that the iron losses are nearly equal to the no-load losses P_0 . Then, from the nominal voltage U_n , the magnetizing current I_m and the no load losses P_0 , it is possible to determine the transformer magnetizing reactance and resistance. The magnetizing conductance is given by (1).

$$G_m = \frac{P_0}{U_n^2} \quad (1)$$

The magnetizing resistance R_m (2) is obtained from the magnetizing conductance G_m (1).

$$R_m = \frac{1}{G_m} \quad (2)$$

From the magnetizing current I_m and the magnetizing conductance R_m it is possible to determine the magnetizing susceptance B_m (3):

$$B_m = -\sqrt{\left(\frac{I_m}{U_n}\right)^2 - G_m^2} \quad (3)$$

The magnetizing reactance X_m is given by (4):

$$X_m = \frac{1}{B_m} \quad (4)$$

The magnetizing impedance is much higher than the series branch impedances (Fig. 1). Then, from the short-circuit test, it is possible to obtain the short-circuit impedance Z_{cc} (5) and the total resistance R_t (6) from the transformer primary and secondary windings, knowing the short-circuit voltage U_{cc} , necessary to guarantee the current nominal value I_n and the short-circuit losses P_{cc} .

$$Z_{cc} = \frac{U_{cc}}{I_n} \quad (5)$$

$$R_t = \frac{P_{cc}}{I_n^2} \quad (6)$$

Then, from (5) and (6) it is possible to determine the leakage reactance X_t (7):

$$X_t = \sqrt{Z_{cc}^2 - R_t^2} \quad (7)$$

The resistance and leakage reactance from the primary and secondary windings may be assumed to be equal. Then:

$$R_1 = R_2 = \frac{R_t}{2} \quad (8)$$

$$X_1 = X_2 = \frac{X_t}{2} \quad (9)$$

In this work a 400kVA 30kV/ 400V distribution transformer (base values $S_b=400\text{kVA}$, $U_b=30\text{kV}$, $I_b = S_b / (\sqrt{3} U_b)$) is used. From the no-load test a magnetizing current $I_m=2.9\%$ and no-load losses of $P_0=1450\text{W}$ are considered. From the short-circuit test it is assumed $U_{cc}=4.5\%$, with nominal current I_n (1 pu) and short-circuit losses $P_{cc}=8.8\text{ kW}$.

2.2 Distribution cables

The distribution cables models are based on the π model (Fig. 2) and their section is chosen according to the current nominal values. The series resistance and inductance and the shunt admittance may be obtained from the manufacturers values depending on the cables section and length.

In LV distribution networks four-wire cables are used (three phase conductors and a neutral conductor insulated separately), all enclosed by an outer polyethylene insulation mantle. Usually the conductors are sector shaped. The shunt and series impedance are determined by the physical construction of the cable.

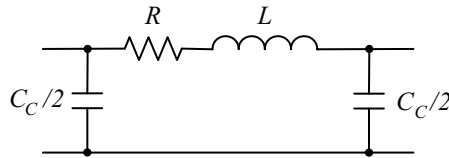


Fig. 2. π model of the distribution electrical network

Based on the single phase model of Fig.2, the model of a three phase distribution cable is obtained, Fig. 3 [Ciric et al 2003], [Ciric et al 2005].

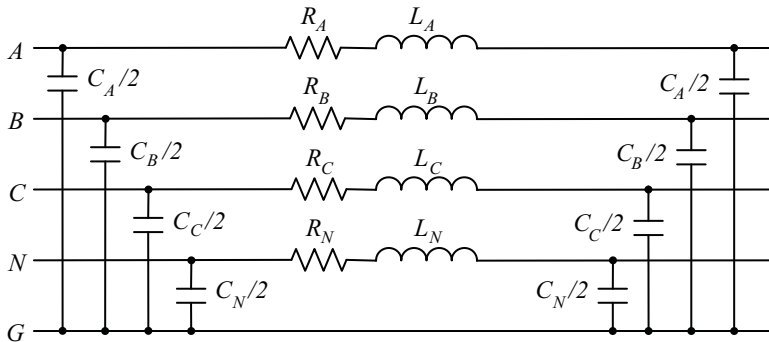


Fig. 3. Modified π model of the distribution electrical network

The series resistance R (Ω/km) [Jensen et al, 2001] depends on the cable internal resistance, on the ground resistance (there is no screen and the current diverted to ground must be included in the model) and on the proximity effect resistance. The skin effect and the proximity effect result in the increase of the conductors resistance.

The cable apparent inductance L_s depends on the self inductance, on the mutual inductance and on the inductance due to non-ideal ground.

The cable shunt admittance depends on the capacitances between conductors and on the conductors to ground capacitances [Jensen et al, 2001].

In overhead lines only the series impedance is considered. The capacitance is usually negligible.

Both for underground cables and overhead lines, the length should be adequate to guarantee their protection, according to the manufacturer values, and to assure that despite the voltage drops, the compliance with RMS voltage standard values [EN 50160] is always guaranteed.

2.3 Linear loads

Linear loads are represented as simple resistances (R) and inductances (RL). Resistive loads may be used to simulate incandescent lamps or conventional heaters, whether inductive loads may be used to simulate refrigerators, according to the measurements performed with a FLUKE 435 and shown in figure 4.

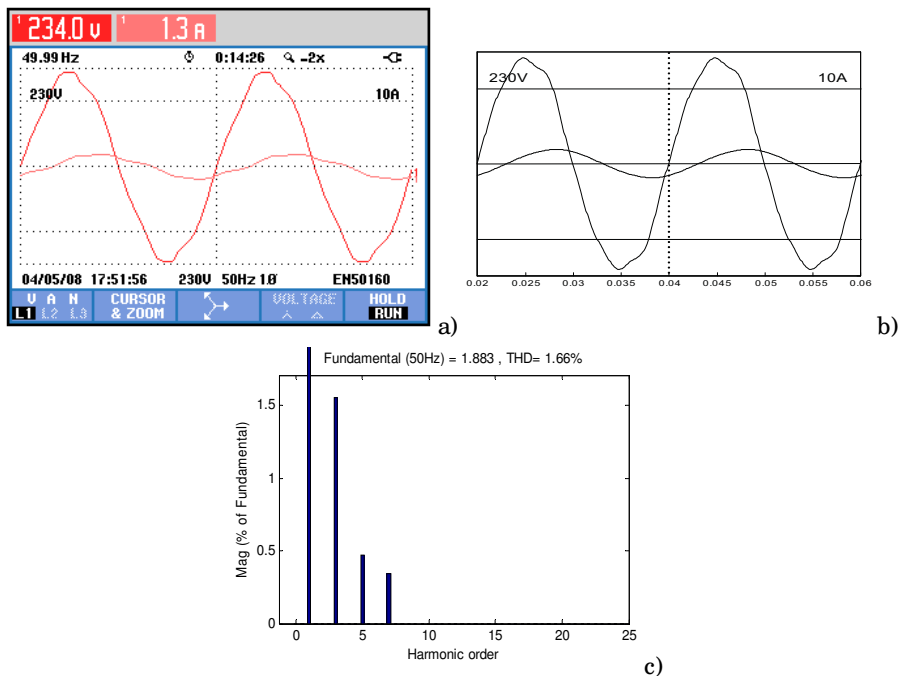


Fig. 4. Grid voltage and current waveform obtained for a refrigerator: a) Measured with a Fluke 435, $THD_i=10.8\%$ and $PF=0.57$; b) Obtained with the simulated model, considering $THD_v=5\%$; c) Simulated current harmonics, $THD_i=1.66\%$ and $PF=0.57$

2.4 Nonlinear loads

Nonlinear loads are assumed to be mainly represented as diode rectifiers and are divided in three groups depending on their rated power.

The first group includes low power electronic equipment as TV sets, DVD players or computers. Usually, these electronic apparatus have isolated DC supplies connected to the grid through single phase rectifiers and they can be modelled as their first stage converter: a single phase rectifier feeding a DC R_o / C_o load (Fig. 5) [Mohan et al, 1995].

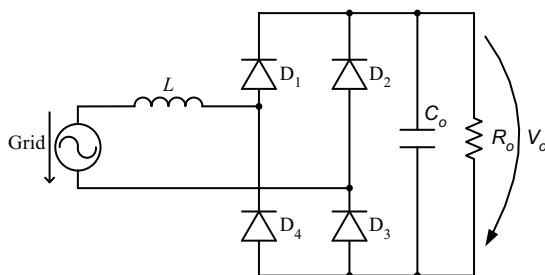


Fig. 5. Single phase rectifier as a model for the majority of electronic apparatus

Fig. 6 shows the voltage and current measurements obtained for a TV set and the equivalent simulated waveforms.

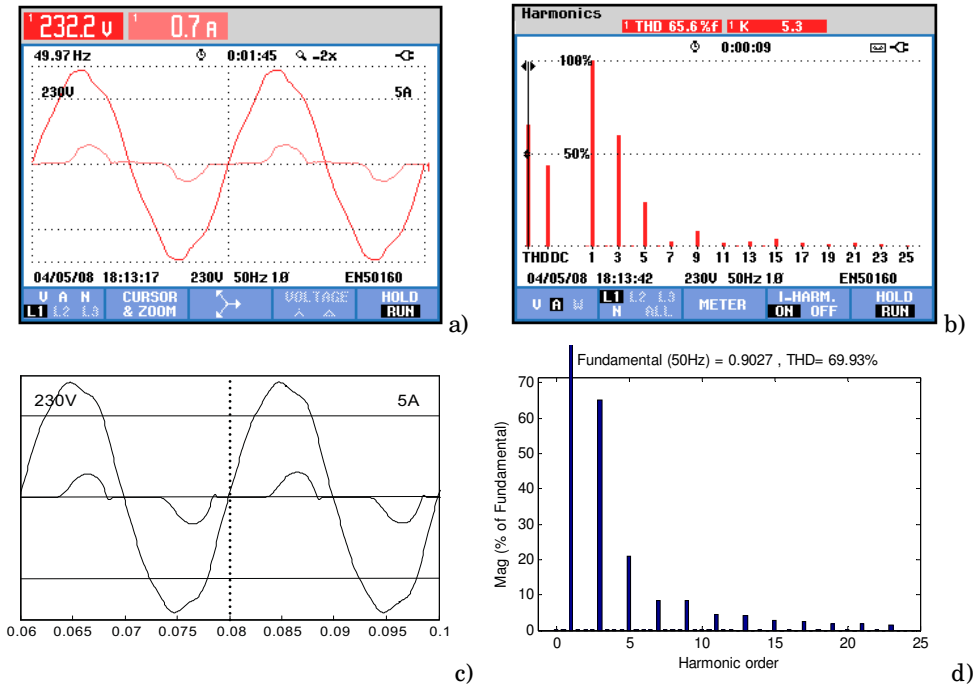


Fig. 6. Grid voltage and current waveform obtained for a TV set; a) b) Measured with a Fluke 435, THD_i=65.6% and PF=0.75; c) Obtained with the simulated model, considering voltage THD_v=5%; d) Simulated current harmonics, THD_i=69.9% and PF=0.76


Fig. 7 shows the voltage and current measurements obtained for a washing machine and the equivalent simulated waveforms.

The virtual lab models of these non linear loads are sized based on their rated power. Then, assuming an adequate DC voltage $V_{o_{av}}$, the value of the equivalent output resistance R_o is obtained from (10). For the TV set an output voltage average value $V_{o_{av}}=300V$ is assumed.


$$R_o \approx \frac{V_{o_{av}}^2}{P} \tag{10}$$

The capacitor C_o is designed to limit the output voltage ripple ΔV_o . Also, it depends on the output voltage average value $V_{o_{av}}$, on the equivalent output resistance R_o , and on the time interval when all the diodes are OFF (approximately equal to one half of the grid period $\Delta t=10ms$). In the simulations, the ripple is assumed to be lower than $\Delta V_o=50V$.


$$C_o \approx \frac{V_{o_{av}}}{R_o} \frac{\Delta t}{\Delta V_o} \tag{11}$$

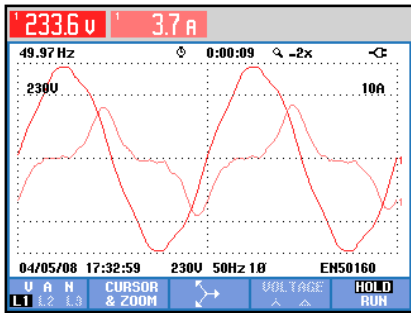


a)

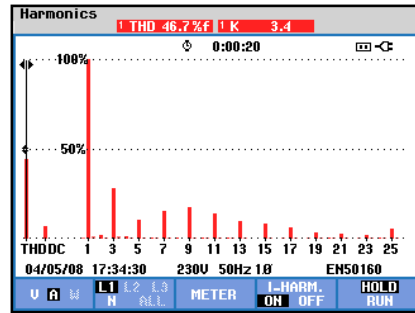


b)

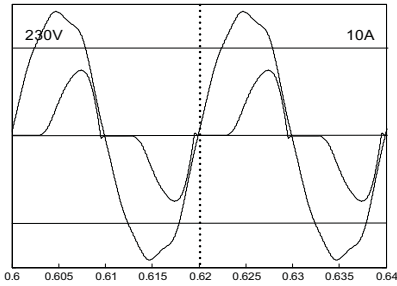


c)

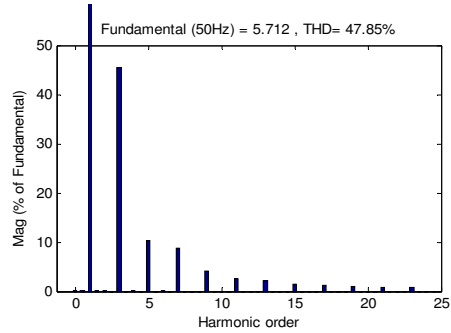

d)

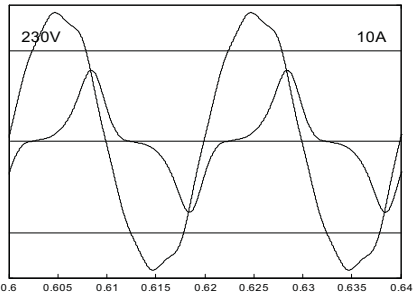

e)

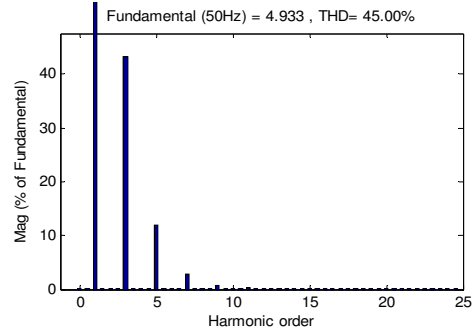

f)

Fig. 7. Grid voltage and current waveform obtained for a washing machine; a) b) Measured with a Fluke 435, $THD_i=46.7\%$; c) Obtained with the simulated model, considering voltage $THD_v=5\%$; d) Simulated current harmonics, $THD_i=47.85\%$ and $PF=0.76$; e) Obtained with the simulated model, considering voltage $THD_v=5\%$ and a saturated inductance; f) Simulated current harmonics, $THD_i=45\%$ and $PF=0.5$

To smooth the current absorbed from the LV network, the rectifier is connected to the grid through a filtering inductance, which is calculated as a percentage of the output load impedance (3), where f represents the grid frequency and k is a constant, usually $k=0.03$ for lower power equipment as TV sets.

$$L_R = \frac{kR_o}{2\pi f} \tag{12}$$

As an example, with the designed model it is possible to obtain current waveforms similar to those measured on a TV set (Fig. 6), using the previously calculated values of R_o , C_o and L_R and assuming $P=150W$.

For other higher power household appliances as modern washing or dishwashing machines, a similar model may be used but the average rated power P should be higher, as well as the input filtering inductance. The voltage and current measurements obtained for a washing machine are shown in Fig. 7 a) b) and the equivalent simulated waveforms are shown in figures 7 c) d) where $P=1kW$, and the filtering inductance is obtained from (12) assuming $k=0.1$. Comparing figures 7 b) and 7 d) the measured and simulated currents THD as well as the harmonic contents are similar. Still, the current waveforms of Fig. 7 a) c) present some differences. To obtain similar current waveforms, the saturation effect of the input inductance should be considered, as shown in Fig. 7 c) d).

Even though the majority of LV grid connected loads are single phase, there may be a few three phase loads, as welding machines or three phase drives in small industries. Again, this equipment may be represented as their first stage converter, usually a three phase diode rectifier feeding an equivalent R_{o3} / C_{o3} load (Fig. 8).

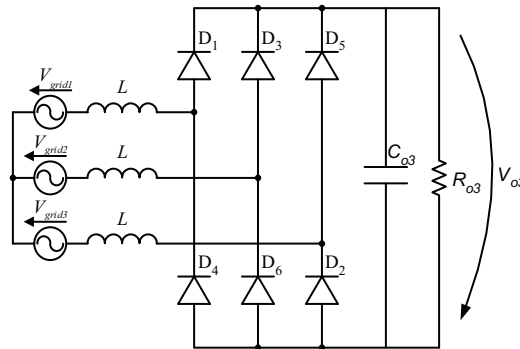


Fig. 8. Three phase rectifier as a model for an electronic equipment of a small industry

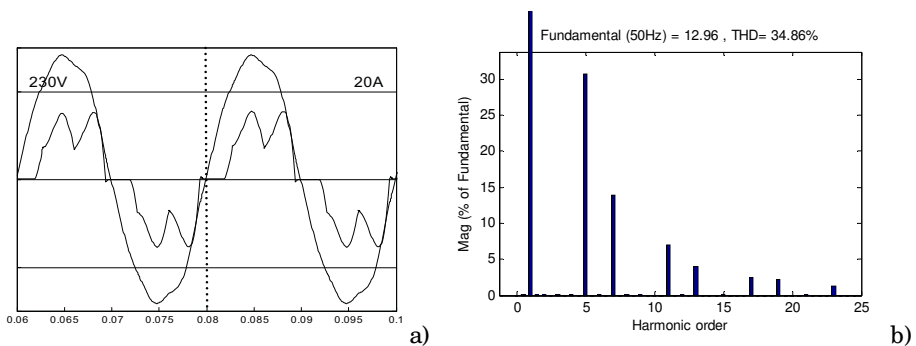


Fig. 9. a) Grid voltage and current waveform obtained for a three phase rectifier obtained with the simulated model, considering voltage $THD_v=5\%$; b) Current harmonics and $THD_i=34.86\%$, $PF=0.91$

In this model the equivalent output load may be calculated from (1) assuming $P=6\text{kW}$ and $V_{o_{av}}=520\text{V}$. The output filter capacitor is obtained from (2) considering $\Delta t=3.3\text{ms}$ (in a 6 pulse rectifier $\Delta t=T/6$). The input filtering inductance is obtained from (3) considering $k=0.03$. Fig. 9 shows the voltage and current waveforms obtained with the designed model.

2.5 Conventional single phase microgenerators

Microgenerators are connected to the LV grid through single phase VSI (voltage source inverters) (Fig. 10) [Pogaku et al, 2007] and they are designed to guarantee the compliance with international standards (as EN 50438) and to have characteristics similar to the authorized equipment (maximum rated power, current THD and input power factor).

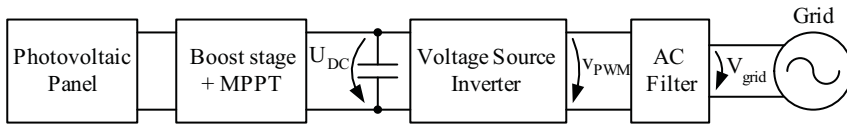


Fig. 10. Block diagram of a conventional μG

For simplicity reasons and minimization of simulation times, the microgenerators are simulated considering only the grid connection stage, as current controlled inverters fed by a DC voltage source U_{DC} (Fig. 11).

It is assumed that the VSI is connected to the grid through a filtering inductance designed to guarantee a current ripple lower than ΔI_{grid} . To minimize filtering, a three level PWM is used. Then, the inductance L_L (Fig. 11) is calculated according to (13), where U_{DC} is the DC link voltage, f_s is the switching frequency and ΔI_{grid} is the current ripple.

$$L_L = \frac{U_{DC}}{4 f_s \Delta I_{grid}} \tag{13}$$

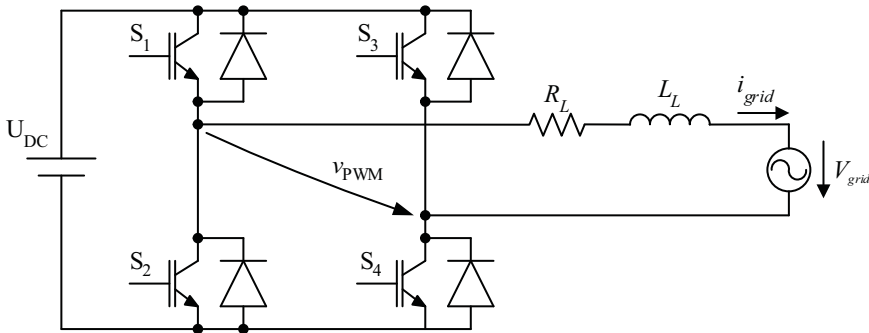


Fig. 11. Model of the single phase microgenerator

The VSI is controlled using a linear control approach, assuming that the maximum power is supplied to the grid and guaranteeing that the current injected in LV grid has a nearly unitary power factor.

Generally, the association of the modulator and the power converter may be represented as a first order model (14), with a gain K_D and a dominant pole dependent on the average delay time T_d (usually one half of the switching period $T_d=T_s/ 2$) [Rashid, 2007].

$$G_C(s) = \frac{v_{PWMav}(s)}{u_c(s)} \approx \frac{K_D}{sT_d + 1} \tag{14}$$

The incremental gain K_D (15) depends on U_{DC} voltage and on the maximum value $u_{c,max}$ of the triangular modulator voltage.

$$K_D = \frac{U_{DC}}{u_{c,max}} \tag{15}$$

To control the current injected in the LV grid it is usual to choose a PI compensator (to guarantee fast response times and zero steady-state error to the step response). The block diagram of the current controller is then represented in Fig. 12, where α_i represents the gain of the current sensor.

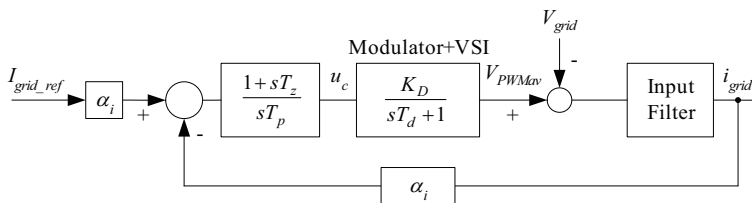


Fig. 12. Block diagram of the current controlled VSI

To design the current controller it is then necessary to obtain the closed loop transfer function of the whole system. To guarantee some insensitivity to the disturbance introduced by the grid voltage V_{grid} , it is assumed that the disturbance is known (is the grid voltage). For simplicity in the controller design, it is considered that the μG sees an equivalent resistance $R_0=V_{grid}/ i_{grid}$ connected to its terminals. From the controller point of view, this results in $R=R_L+R_0$. Then, making the compensator zero T_z coincident with the pole introduced by the input filter $T_z = L_L/R$, the second order transfer function of the current controlled VSI is obtained from (16).

$$G_{cl}(s) = \frac{i_{grid}(s)}{i_{grid,ref}(s)} = \frac{\frac{K_D \alpha_i}{T_p T_d R}}{s^2 + \frac{1}{T_d} s + \frac{K_D \alpha_i}{T_p T_d R}} \tag{16}$$

The transfer function (16) is then compared to the second order transfer function (17) written in the canonical form.

$$G_2(s) = \frac{\omega_n^2}{s^2 + 2\zeta\omega_n s + \omega_n^2} \tag{17}$$

From (16) and (17), assuming a damping factor $\xi = \sqrt{2}/2$, the value of T_p is obtained from (18).

$$T_p = \frac{2K_D \alpha_i T_d}{R} \tag{18}$$

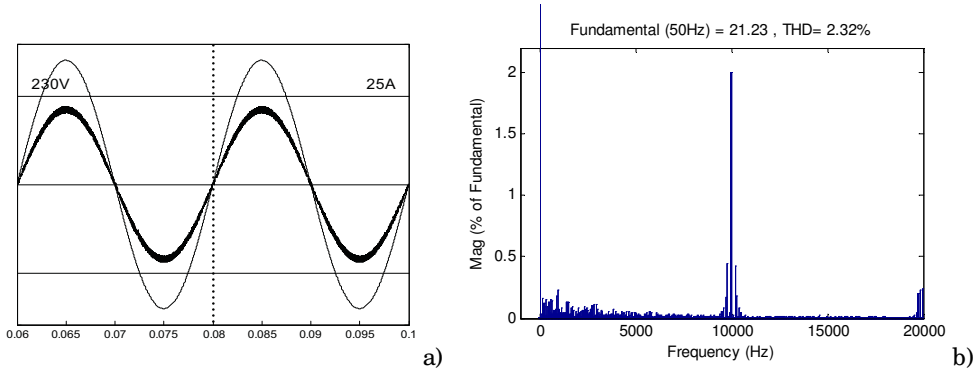


Fig. 13. a) Current and voltage waveforms of a single phase VSI obtained with the simulated model; b) Current harmonics and THD_i=2.33%, PF=-0.999

Figure 13 shows the results obtained for the proposed μ G model, assuming that the μ G apparent power is $S=3450VA$, the DC voltage is $U_{DC}=400V$, the switching frequency is near 10kHz and $\Delta I_{grid} < 0.1 I_{grid}$.

The μ G power factor is negative, even though nearly unitary as the displacement factor between the voltage and the current is 180°. The current THD is lower than 3%. However, considering only the first 50 harmonics, as in most power quality meters, the current THD decreases to THD_i=0.35% These results are according to the manufacturers values, guaranteeing the compliance with international standards.

Even though these microgenerators are designed to present high power quality parameters (high power factor and low current THD), still they are not usually exploited to their full extent as in general, they are sized and the controllers are designed only to minimize the impact on the LV grid. The mitigation of Power Quality issues is not considered.

As an example, consider a small LV grid, as the one represented in figure 14, with a μ G and a non-linear load.

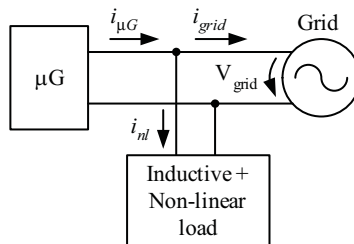


Fig. 14. Example of a small LV grid with a μ G and a non-linear load

Using the previously designed μG the current $i_{\mu G}$ (Fig. 14) will be equal to the one obtained in Fig. 13. The non-linear load current i_{nl} is represented in Fig. 15 and is characterized by $THD_i=47.55\%$.

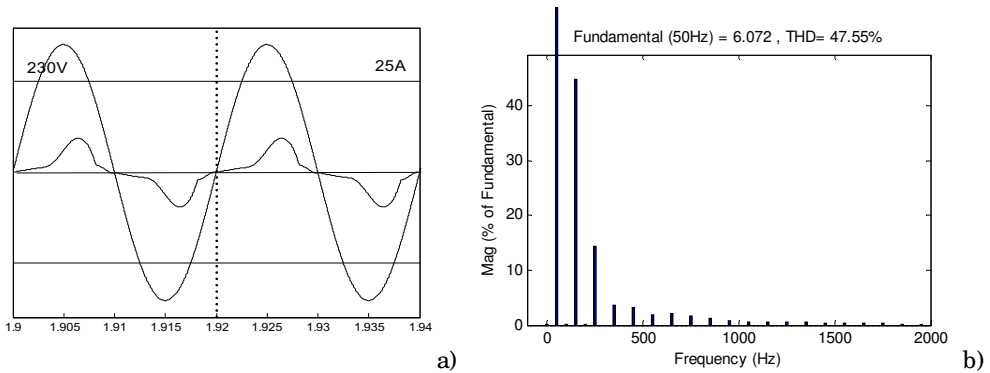


Fig. 15. a) Grid voltage V_{grid} and current waveform i_{nl} obtained for the non-linear load; b) Current harmonics and $THD_i=47.55\%$, $PF=0.15$

The grid current i_{grid} is represented in Fig. 16 and, as a result of the non-linear load $THD_i=18.79\%$.

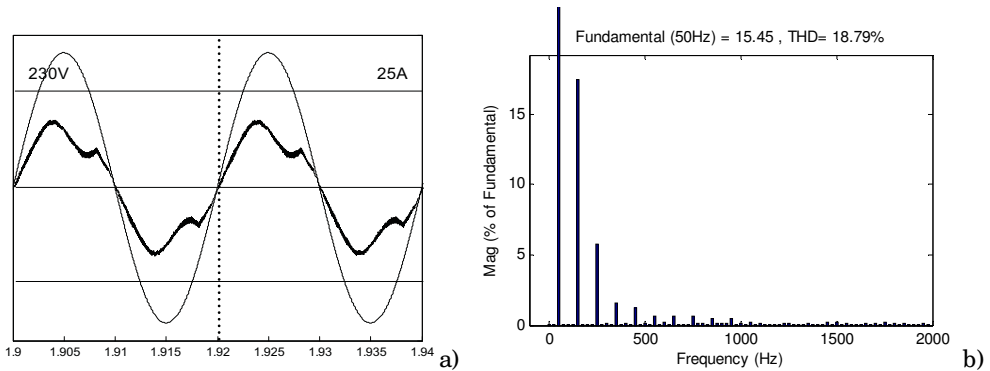


Fig. 16. a) Waveforms of grid voltage V_{grid} and current i_{grid} ; b) Current harmonics and $THD_i=18.79\%$

From this example it is possible to conclude that even though the μG injects nearly sinusoidal currents in the grid (Fig. 13), still it is not capable of guaranteeing sinusoidal currents when other nonlinear loads are connected to the grid.

2.6 Active microgenerators

To minimize some power quality problems as current and voltage THD, an active μG is included in this Lab (Fig. 17). Even though using the same power electronics converters as the conventional μG , with adequate control strategies and adequate filtering, it is possible to guarantee its operation as active power filter (APF), allowing the local mitigation of some

power quality issues, as current THD, reducing the LV grid harmonic pollution (and near unitary power factor).

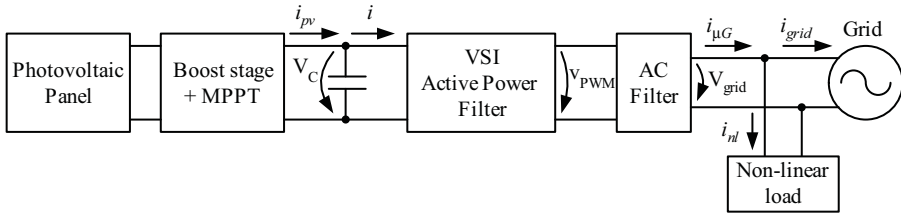


Fig. 17. Block diagram of an active μG

Based on the conventional μG model (Fig. 11), the proposed active μG is simulated according to Fig. 18, considering the DC link filtering stage and the disturbance introduced by the current i_{pv} of the photovoltaic panel + boost stage.

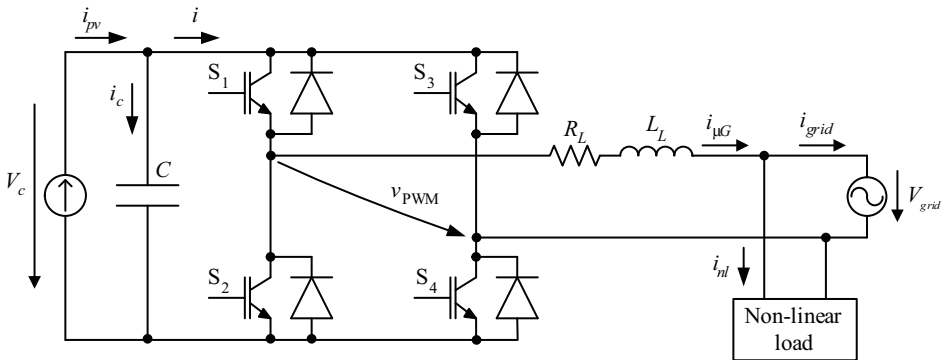


Fig. 18. Model of the single phase active microgenerator

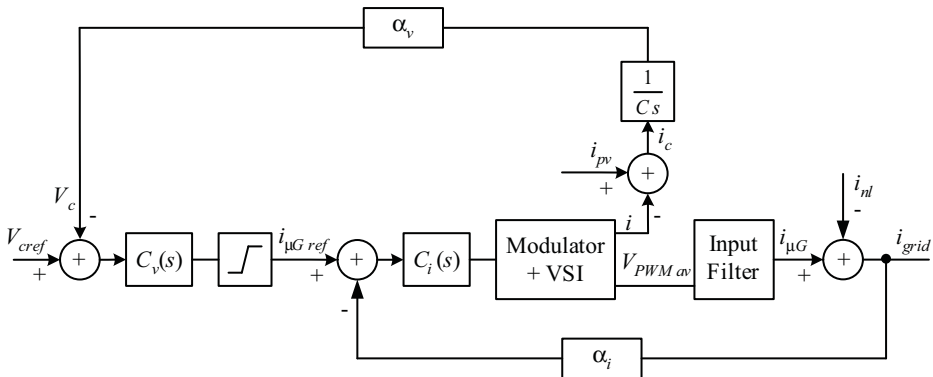


Fig. 19. Diagram block of the DC voltage controller and of the grid current controller to guarantee active filtering of the current harmonics introduced by the non-linear load

Assuming that the V_c voltage dynamics in the DC link is considerably slower than the dynamics of the microgenerator AC current $i_{\mu G}$, then the active μG current $i_{\mu G}$ and the voltage V_c may be controlled according to the diagram block of Fig. 19.

The active μG current controller design is equal to the design of the controller used for the conventional μG . Then, neglecting the high frequency poles, the current controlled system may be represented according to (19), where the controller gain G_i (20) is obtained from the input/ output power constraint, where V_{max} represents the amplitude of the grid voltage.

$$\frac{i(s)}{i_{\mu G ref}(s)} \approx \frac{\frac{G_i}{\alpha_i}}{T_{dv} s + 1} \tag{19}$$

$$G_i(s) \approx \frac{V_{max}}{2V_c} \tag{20}$$

Then, the current controlled system may be represented as a current source (19), as shown in Fig. 20.

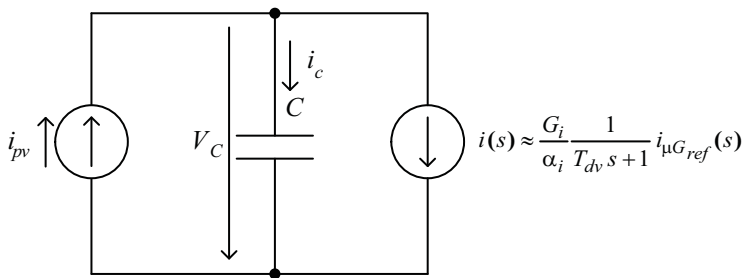


Fig. 20. Simplified block diagram used to design the voltage controller

From Fig. 20, the block diagram of the DC voltage controller is obtained and represented in figure 21.

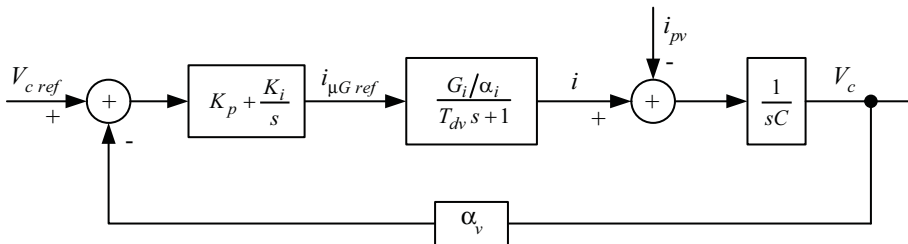


Fig. 21. Block diagram of DC stage voltage controller

From Fig. 21, the voltage response to the disturbance introduced by the photovoltaic panel is given by (21):

$$\left. \frac{v_c(s)}{i_{pv}(s)} \right|_{v_{crf}=0} = \frac{\frac{1}{sC}}{1 + \alpha_v \left(K_p + \frac{K_i}{s} \right) \frac{G_i}{\alpha_i} \frac{1}{T_{dv}s + 1} \frac{1}{sC}} \quad (21)$$

Simplifying (21) it is possible to obtain the transfer function in the canonical form (22).

$$\left. \frac{v_c(s)}{i_{pv}(s)} \right|_{v_{crf}=0} = \frac{s \frac{\alpha_i}{T_{dv} C \alpha_i} (T_{dv} s + 1)}{s^3 + \frac{1}{T_{dv}} s^2 + \frac{\alpha_v G_i K_p}{T_{dv} C \alpha_i} s + \frac{\alpha_v G_i K_i}{T_{dv} C \alpha_i}} \quad (22)$$

From the final value theorem (23), the response to the disturbance introduced by i_{pv} current is zero, meaning that in steady-state, the PI controller guarantees the minimization of the disturbances.

$$\lim_{s \rightarrow 0} \left. \frac{v_c(s)}{i_{pv}(s)} \right|_{v_{crf}=0} = 0 \quad (23)$$

To determine the PI controller parameters, the denominator of (22) is compared to the third order polynomial (24).

$$P_3(s) = s^3 + 1.75\omega_0 s^2 + 2.15\omega_0^2 s + \omega_0^3 \quad (24)$$

Then:

$$\begin{cases} 1.75\omega_0 = \frac{1}{T_{dv}} \\ 2.15\omega_0^2 = \frac{\alpha_v G_i K_p}{T_{dv} C \alpha_i} \\ \omega_0^3 = \frac{\alpha_v G_i K_i}{T_{dv} C \alpha_i} \end{cases} \quad (25)$$

Solving (25), the proportional gain K_p and the integral gain K_i are obtained:

$$\begin{cases} K_p = \frac{2.15 C \alpha_i}{\alpha_v G_i T_{dv} (1.75)^2} \\ K_i = \frac{C \alpha_i}{\alpha_v G_i (1.75)^3 (T_{dv})^2} \end{cases} \quad (26)$$

Assuming that the dynamics of V_c voltage is considerably slower than the dynamics of the microgenerator AC current $i_{\mu G}$, then the pole T_{dv} is assumed to be $T_{dv} \approx 2T$, where T is the grid period.

Figures 22 to 24 show the results obtained for the proposed active μG model, assuming that the μG apparent power is $S=3450VA$, the DC voltage is controlled to be $V_c=400V$, the semiconductors switching frequency is near 10kHz and $\Delta I_{grid} < 0.1 I_{grid}$. The DC link capacitor

is $C=2.7\text{mF}$, guaranteeing a voltage ripple lower than 5%. The results obtained for the non-linear load are those presented in figure 15.

From Fig. 22 it is possible to conclude that the proposed active μG acts as an active power filter, guaranteeing nearly sinusoidal grid currents. Comparing the results of Fig. 22 and Fig. 16, there is a clear reduction of the grid current THD. This reduction will become more obvious for more complex grids and highly non-linear loads.

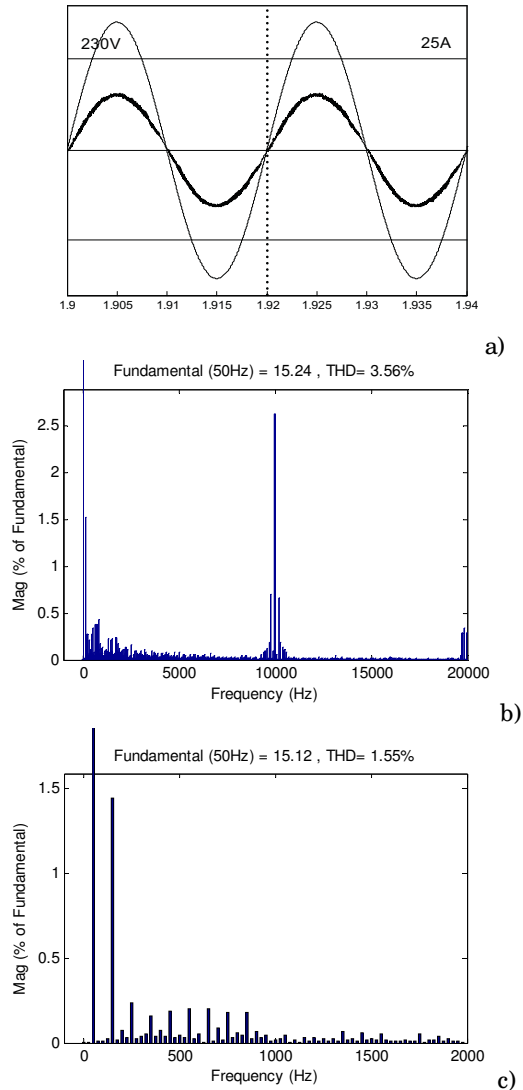


Fig. 22. a) Waveforms of grid voltage and current; b) Grid current harmonics and $\text{THD}_i=3.56\%$, $\text{PF}=0.9999$; c) Grid current harmonics and $\text{THD}_{i50}=1.55\%$ (considering only till the 50th order harmonic)

To guarantee nearly sinusoidal grid currents, the μ G current will be the one presented in Fig. 23.

The average value of the capacitor voltage is $V_c=400V$, as shown in Fig. 24.

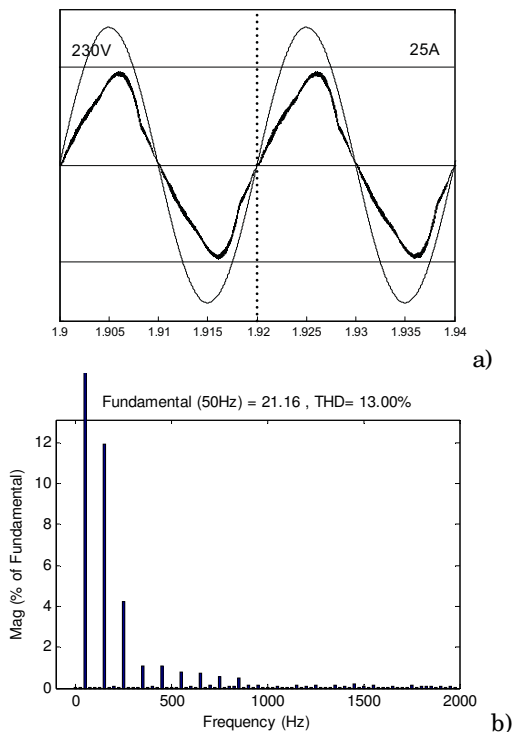


Fig. 23. a) Waveforms of grid voltage and μ G current; b) μ G current harmonics and $THD_i=13\%$

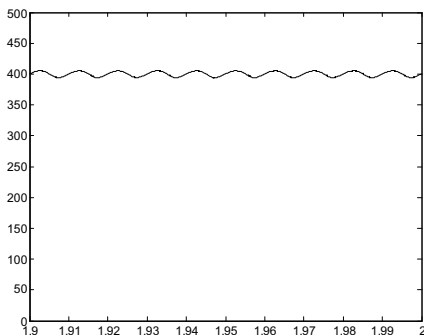


Fig. 24. Waveform of the DC link capacitor voltage

The proposed models will be further tested in a low voltage grid.

3. Modelling the Low Voltage grid

The performance of microgenerators can be compared in this virtual lab using the designed low voltage grid model with six clusters of loads (Fig. 25). It is assumed that 85% of these loads are non-linear and 15% are linear. Also, on the transformer Medium Voltage side the 5th and 7th harmonics are considered. At the Low Voltage side it is assumed that the voltage RMS value is 2.5% above the nominal value.

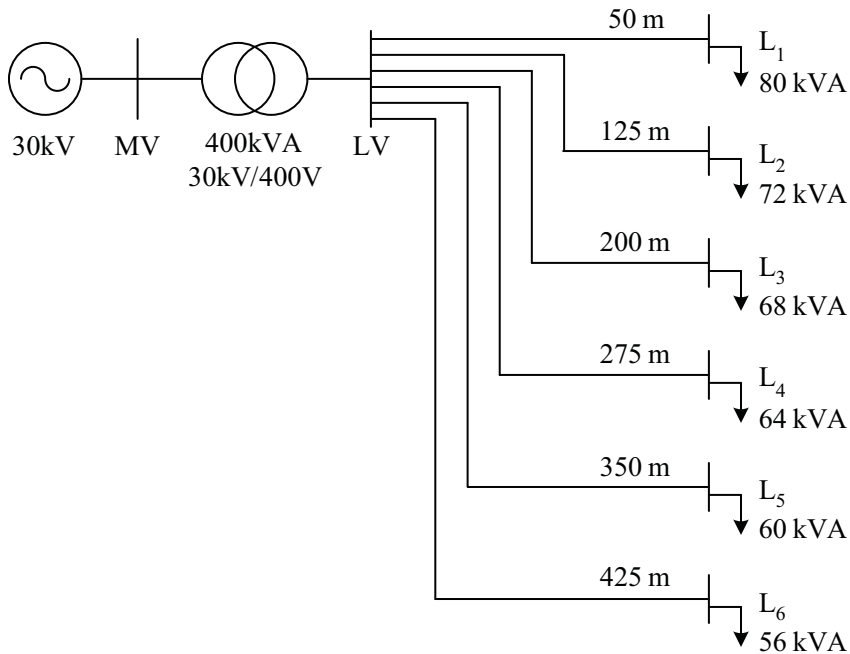


Fig. 25. Topology of the simulated LV grid

The simulations are carried out assuming two different load scenarios:

- Distribution transformer at 15% of its nominal power (S_N) (nearly no load scenario, assuming 15% of values represented in Fig. 25);
- Distribution transformer at 85% of its nominal power (full load scenario, assuming 85% of values represented in Fig. 25).

Each one of these scenarios is tested:

- without μG ;
- with conventional μG ;
- with active μG .

It is assumed that the microgeneration total power never exceeds 25% of the transformer rated power S_N .

Figure 26 presents the results obtained without μG , assuming that the transformer may be at 15% or at 85% of its rated power S_N . The measurements of phase voltages and currents are carried out on the transformer LV side for each one of the groups of loads L_1 to L_6 .

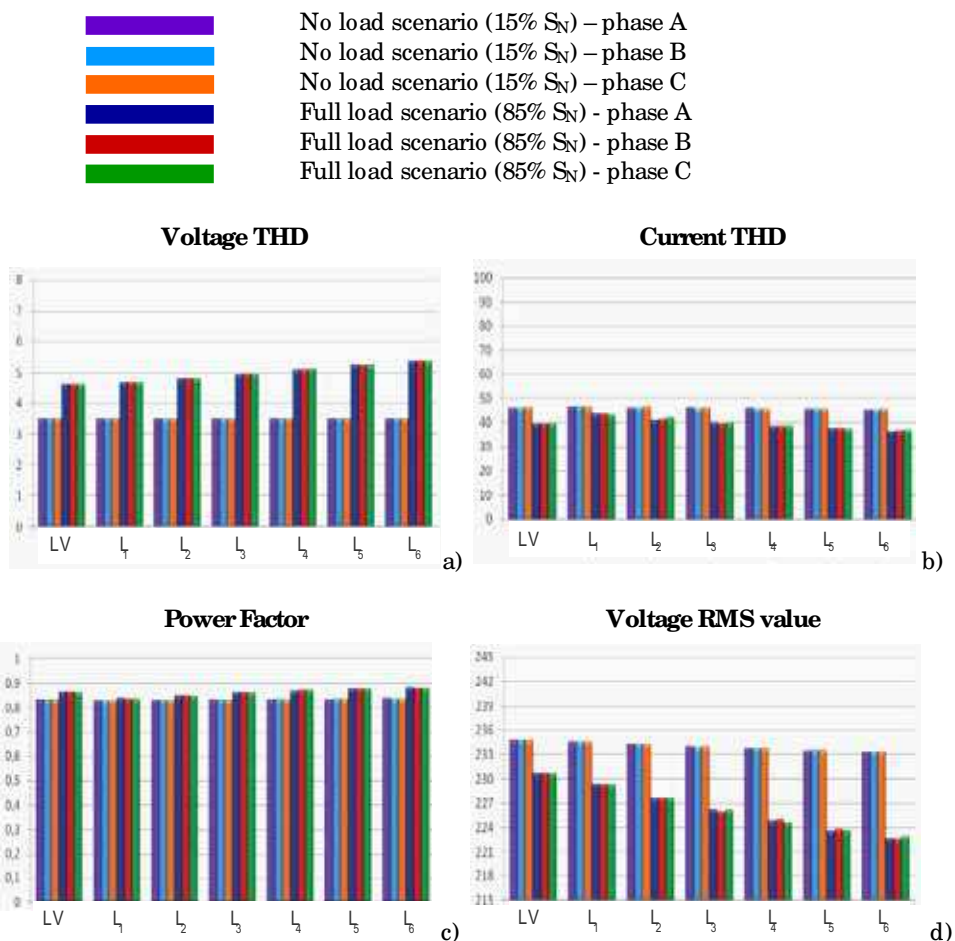


Fig. 26. Results obtained for 15 % and 85 % of the transformer rated power, without μG . Measurements carried out on the transformer LV side for each one of the groups of loads L1 to L6: a) Voltage THD; b) Current THD; c) Power Factor; d) Value of RMS voltage

Fig. 26 shows that the voltage THD increases more than 50% (as in load 6) from the no-load (15% S_N) to the full load (85% S_N) scenario. As the percentage of linear and non-linear loads is nearly equal for both scenarios, the current THD does not present significant changes (it even decreases slightly in the full load scenario). Also, the Power Factor results are similar for both scenarios, even though slightly lower for the no-load scenario. As for the load voltages RMS values, higher loads result in higher voltage drops. Also, as the transformer to load distance increases, the voltage drop increases as well.

Figure 27 presents the results obtained with μG assuming that the transformer is at 15 % of its rated power S_N (no load scenario). The measurements of phase voltages and currents are carried out on the transformer LV side for each one of the groups of loads L₁ to L₆.

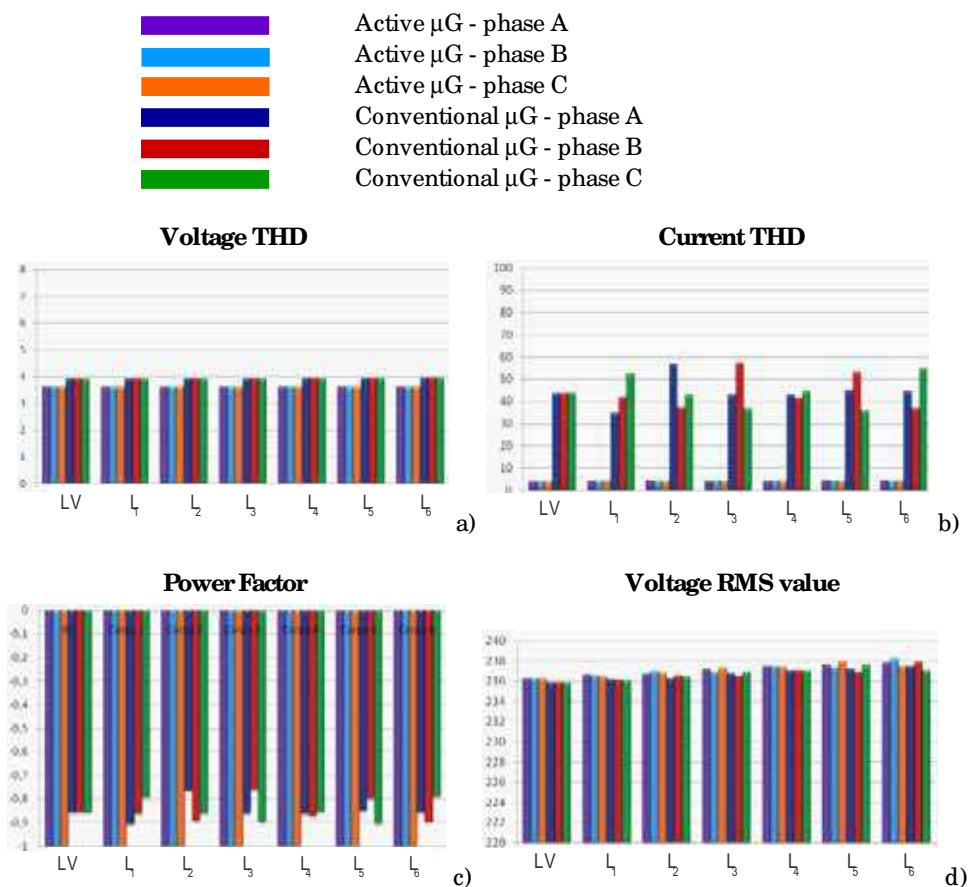


Fig. 27. Results obtained for 15% S_N of conventional μ G or active μ G: a) Voltage THD; b) Current THD; c) Power Factor; d) Value of RMS voltage

From the results obtained for the first scenario (15% S_N) (Fig. 27), the use of active μ G guarantees a clear improvement of voltage and current THD, when compared to the conventional μ G. Also, the use of active μ G guarantees near unity power factor, even though it is negative. This results from the fact that the power flows from the microgenerators to the transformer, instead of flowing from the transformer to the loads.

Figure 28 presents the results obtained with μ G assuming that the transformer is at 85 % of its rated power S_N (full load scenario). The measurements of phase voltages and currents are carried out on the transformer LV side for each one of the groups of loads L_1 to L_6 .

The results obtained for the full load scenario (85% S_N) (Fig. 28) show the improvement introduced by active μ G in voltage THD (Fig 28a), as well as current THD (Fig 28b) and power factor (Fig 28c). From Fig. 28 active microgeneration allows a voltage THD reduction up to 30%, when compared to conventional microgeneration. Also, comparing with the values obtained without microgeneration (Fig. 26) it is possible to conclude that

conventional microgeneration slightly increases voltage THD, while active microgeneration reduces voltage THD.

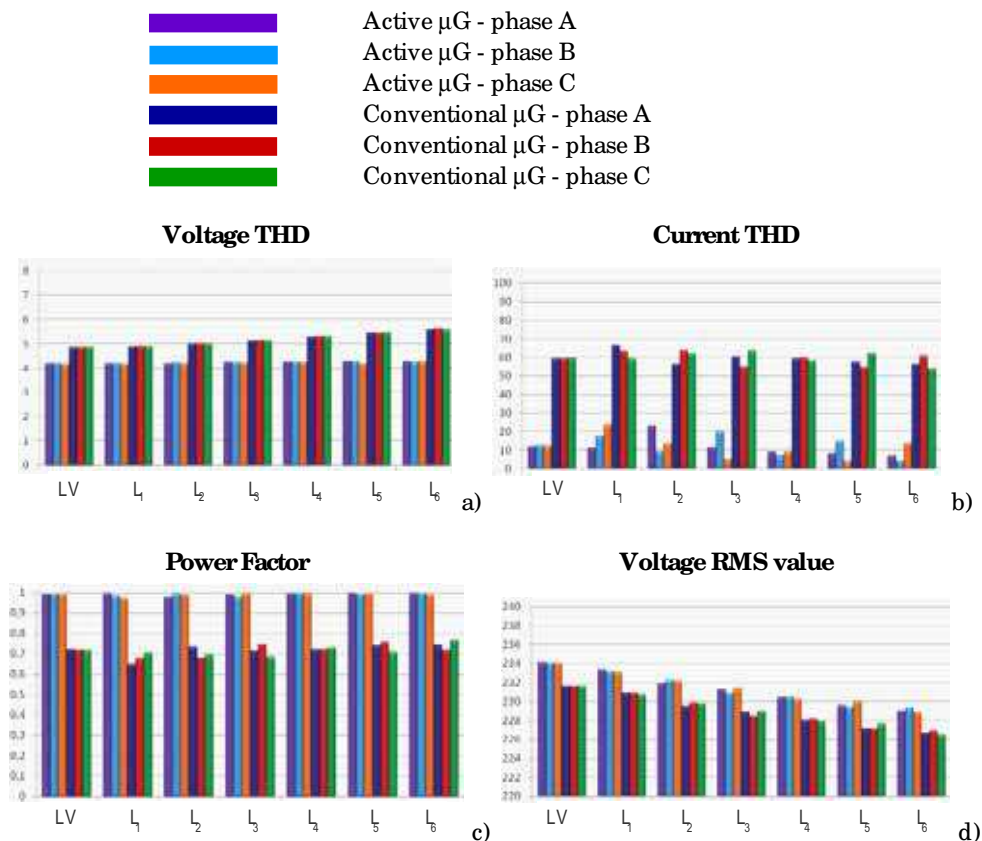


Fig. 28. Results obtained for 85% S_N of conventional μG or active μG ; a) Voltage THD; b) Current THD; c) Power Factor

4. Conclusions

In this paper a virtual lab was designed to evaluate and mitigate some power quality problems introduced by μG . The virtual lab includes the Medium/ Low voltage (MV/ LV) transformer, the distribution lines, linear and non-linear loads, conventional μG and active μG . To validate the designed models, the current waveforms and distortion obtained for each one of the virtual lab loads were compared to those measured with the most used electric and electronic equipment, showing that the obtained results are similar.

The μG model is simulated based on its final stage converter, a single phase inverter, while the active μG also includes high order harmonics compensation, to perform as an active power filter.


Using the proposed models a small low voltage grid model with six clusters of loads is designed to evaluate the impact of conventional μG and active μG on Power Quality for a no-load and a full load scenario.

From the results obtained with the virtual lab LV grid, it was possible to conclude that conventional μG slightly increases voltage THD, while active μG reduces voltage THD (up to 30% when compared to voltage THD values obtained with conventional μG), guaranteeing an overall Power Quality improvement (Power Factor increase).

Even though the μG total power never exceeds 25% of the transformer rated power S_N , with a high percentage of non linear loads, as the one considered in the proposed virtual lab LV grid model (85% of the transformer rated power), the active μG presents promising results and it can be concluded that it may be a solution to mitigate some power quality problems.

5. References

- Ciric, R. M.; Ochoa, L. F.; Padilla-Feltrin, A.; Nouri, H.; *Fault Analysis in Four Wire Distribution Networks*; IEE Proceedings on Generation, Transmission and Distribution, Vol. 152, No 6, November 2005.
- Ciric, R. M.; Padilla-Feltrin, A.; Ochoa, L. F.; *Power Flow in Four-Wire Distribution Networks – General Approach*; IEEE Transactions on Power Systems, Vol. 18, No 4, November 2003.
- Elgerd, O.; *Electric Systems Theory: an Introduction*, 2nd ed., 1985, International Student Edition, Mc Graw Hill, ISBN 0-07-Y66273-8, Singapore.
- EN 50160, *Voltage Characteristics of Electricity Supplied by Public Distribution Networks*, European Standard EN 50160, 2001.
- EN 50438, *Requirements for the Connection of Micro-Generators in Parallel with Public Low Voltage Distribution Networks*, European Standard EN 50438, 2007.
- Jensen, M. H.; Bak-Jensen, B.; *Series Impedance of the Four-Wire Distribution Cable with Sector-Shaped Conductors*, Proc. of PPT 2001, IEEE Porto Power Tech Conference, Porto, Portugal, September 2001.
- Jensen, M. H.; Bak-Jensen, B.; *Shunt Admittance of the Four-Wire Distribution Cable with Sector-Shaped Conductors*, Proc. of AUPEC'2001, Australasian University Power Engineering Conference, Perth, Australia, September 2001.
- Mohan, N.; Undeland, T.; Robbins, W.; *Power Electronics: Converters, Applications and Design*, 2nd Edition, 1995, John Wiley and Sons, ISBN 0-471-58408-8, USA.
- Pogaku, N.; Prodanovik, M.; Green, T.; *Modeling, Analysis and Testing of Autonomous Operation of an Inverter Based Microgrid*, IEEE Transactions on Power Electronics, Vol. 22, No 2, March 2007.
- Rashid, M.; *Power Electronics Handbook*, 2nd edition, 2007, Academic Press, Elsevier, ISBN 13: 978-0-12-088479-7, ISBN 10: 0-12-088479-8, USA.

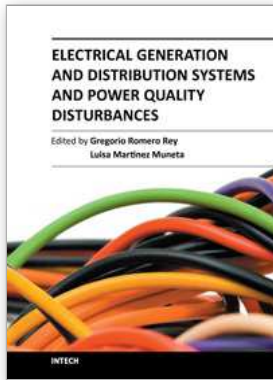

Electrical Generation and Distribution Systems and Power Quality Disturbances

Edited by Prof. Gregorio Romero

ISBN 978-953-307-329-3

Hard cover, 304 pages

Publisher InTech

Published online 21, November, 2011

Published in print edition November, 2011

The utilization of renewable energy sources such as wind energy, or solar energy, among others, is currently of greater interest. Nevertheless, since their availability is arbitrary and unstable this can lead to frequency variation, to grid instability and to a total or partial loss of load power supply, being not appropriate sources to be directly connected to the main utility grid. Additionally, the presence of a static converter as output interface of the generating plants introduces voltage and current harmonics into the electrical system that negatively affect system power quality. By integrating distributed power generation systems closed to the loads in the electric grid, we can eliminate the need to transfer energy over long distances through the electric grid. In this book the reader will be introduced to different power generation and distribution systems with an analysis of some types of existing disturbances and a study of different industrial applications such as battery charges.

How to reference

In order to correctly reference this scholarly work, feel free to copy and paste the following:

Sonia Pinto, J. Fernando Silva, Filipe Silva and Pedro Frade (2011). Design of a Virtual Lab to Evaluate and Mitigate Power Quality Problems Introduced by Microgeneration, Electrical Generation and Distribution Systems and Power Quality Disturbances, Prof. Gregorio Romero (Ed.), ISBN: 978-953-307-329-3, InTech, Available from: <http://www.intechopen.com/books/electrical-generation-and-distribution-systems-and-power-quality-disturbances/design-of-a-virtual-lab-to-evaluate-and-mitigate-power-quality-problems-introduced-by-microgeneratio>

INTECH
open science | open minds

InTech Europe

University Campus STeP Ri
Slavka Krautzeka 83/A
51000 Rijeka, Croatia
Phone: +385 (51) 770 447
Fax: +385 (51) 686 166
www.intechopen.com

InTech China

Unit 405, Office Block, Hotel Equatorial Shanghai
No.65, Yan An Road (West), Shanghai, 200040, China
中国上海市延安西路65号上海国际贵都大饭店办公楼405单元
Phone: +86-21-62489820
Fax: +86-21-62489821

© 2011 The Author(s). Licensee IntechOpen. This is an open access article distributed under the terms of the [Creative Commons Attribution 3.0 License](#), which permits unrestricted use, distribution, and reproduction in any medium, provided the original work is properly cited.